Vsak prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
This document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

SUCKING
AIRFLOW DIRECTION
SMER ZRAKA

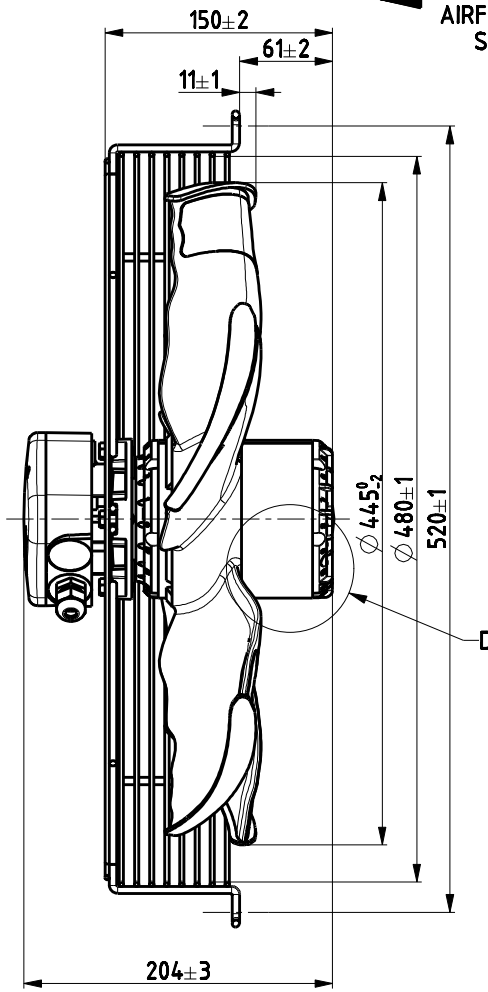

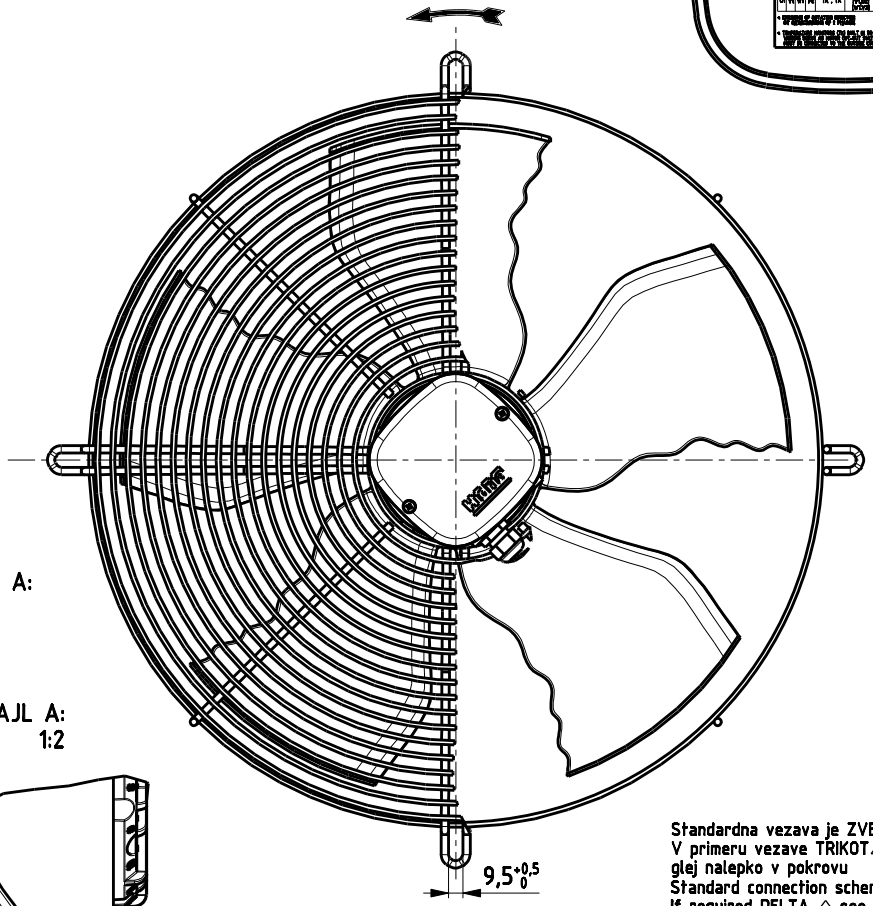

DETAJL A:
1:2



Pozicija ventilatorja
Position of fan

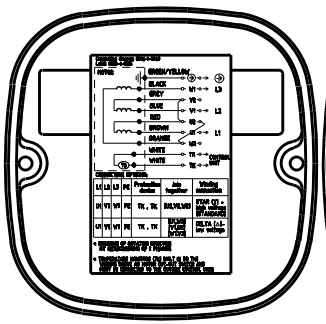

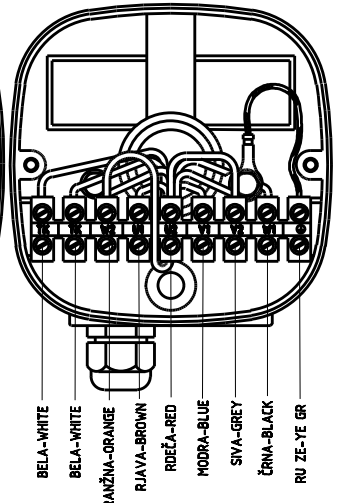

Connecting diagram 0301-1-0049
Label 0300-1-9125

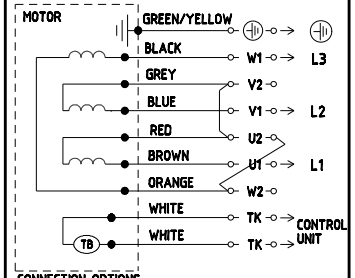

CONNECTION OPTIONS:

L1	L2	L3	PE	Protection device	Join together	Winding connection
U1	V1	W1	PE	TK , TK	[U2,V2,W2]	STAR (Y) - high voltage (STANDARD)
U1	V1	W1	PE	TK , TK	[U1,W2] [V1,U2] [W1,V2]	DELTA (△)- low voltage

* CHANGING OF ROTATION DIRECTION BY INTERCHANGING OF 2 PHASES!
* TEMPERATURE MONITORS (TK) BUILT IN TO THE WINDING SERVE AS MOTOR CUT-OUT SWITCH AND MUST BE CONNECTED TO THE OUTSIDE CONTROL UNIT!

Standardna vezava je ZVEZDA Y
V primeru vezave TRIKOT △
glej nalepko v pokrovu
Standard connection scheme is STAR Y
If required DELTA △ see the
connection diagram in the cover

Opombe:
- navodilo za kontrolo ventilatorja 0301-1-4700
- checking instruction 0301-1-4700

Hidria Rotomatika

MADE IN SLOVENIA | CE | DATE

R11R-45LPS-4T-5757
3 ~Y400/D230V 50Hz 260W 0,55/0,95A 1250RPM
3 ~Y400/D230V 60Hz 350W 0,60/1,05A 1350RPM
TH.PROT. INS.CL.F IP54
ROT. 0311-4-0378

ST.	ST.SPR.	DATUM	PODPIS
1	309/10	22-Nov-2010	Uroš K.

NETOLERIRANE MERE UNTOLERANCED DIM. ISO 2768-m
MERILO/FORMAT 3:10 / A3
POVRSINSKA OBD. SURFACE TEXTURE
MATERIAL

	DATUM	PODPIS
RISAL	22-Nov-2010	Uroš K.
PROJEKTIRAL	22-Nov-2010	Matej B.
POTRDIL ROTOMATIKA MOTORS		
POTRDIL OPT LIVARSTVO		
POTRDIL SPM LJUBLJ		
POTRDIL ROTOMATIKA FANS		
POTRDIL		

NAZIV: TITLE: VENTILATOR R11R-45LPS-4T-5757
KODA: CODE: 0311-4-0378 (0311-4-0378)
VERZIJA: REV:
LIST: SHEET: 1
OD: OF: 1